



CROSS SECTIONS

VERTICAL PLACEMENT OF WALK WHEN SEPARATED FROM CURB BY SWALE OR PLANTER STRIP

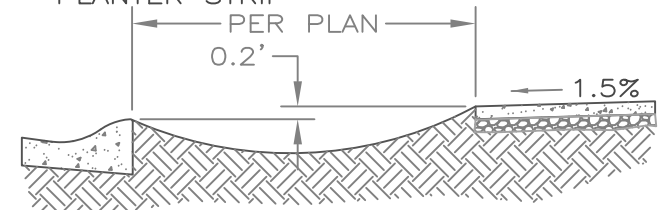

ROLLED CURB

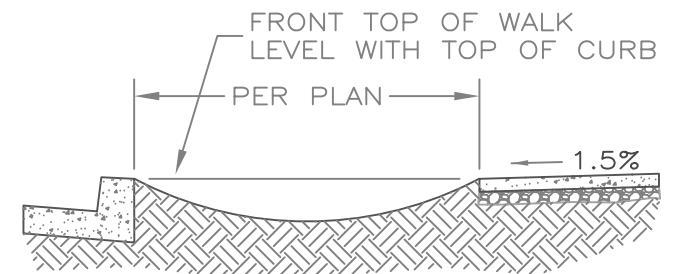

STANDARD CURB OR CURB AND GUTTER

NOTES:

1. TOOL JOINTS SHALL BE PLACED EVERY 5 FEET AND MATCH CURB JOINTS.
2. EXPANSION JOINTS SHALL BE PLACED EVERY 20 FEET AND AT COLD JOINTS WITH FELT EXPANSION MATERIAL EXTENDING THE FULL SIDEWALK DEPTH.
3. EXPANSION MATERIAL IS REQUIRED BETWEEN A DRIVEWAY SLAB AND THE WALK. IT IS ALSO REQUIRED BETWEEN THE SIDEWALK AND THE DRIVE APPROACH. EXPANSION MATERIAL SHALL EXTEND THE FULL DEPTH OF THE WALK.
4. SIDEWALK SHALL SLOPE TOWARDS THE CURB AT 1.5%.
5. SIDEWALK SHALL BE 4" THICK EXCEPT WHEN HAND FORMED AS PART OF A DRIVEWAY WHERE IT SHALL BE 5-1/2" THICK.

APPROVED BY:

POST FALLS STANDARDS FOR PUBLIC WORKS CONSTRUCTION

[Signature] 3/19/19
CITY ENGINEER, P.E. DATE:

SIDEWALK DETAIL

STANDARD DRAWING
NO. SD 2012