


NOTES:

1. VALVE BOX SHALL BE SET 1/4" BELOW ASPHALT SURFACE.  
AND NOT LOCATED WITHIN THE CURB SECTION
2. ALL THRUST BLOCKS SHALL BE PLACED PER SD-403.
3. SERVICE MARKER SHALL BE PAINTED BLUE AND EXTEND AT LEAST 12" ABOVE ADJACENT GROUND AND TRACER WIRE TERMINATED AT BASE.
4. HOT TAPS OF EXISTING MAINS ARE ALLOWED AS LONG AS THE MAIN DIAMETER IS AT LEAST 1 PIPE SIZE GREATER THAN THE SERVICE SIZE.
5. METER SETTINGS SHALL CONFORM TO SD 408.

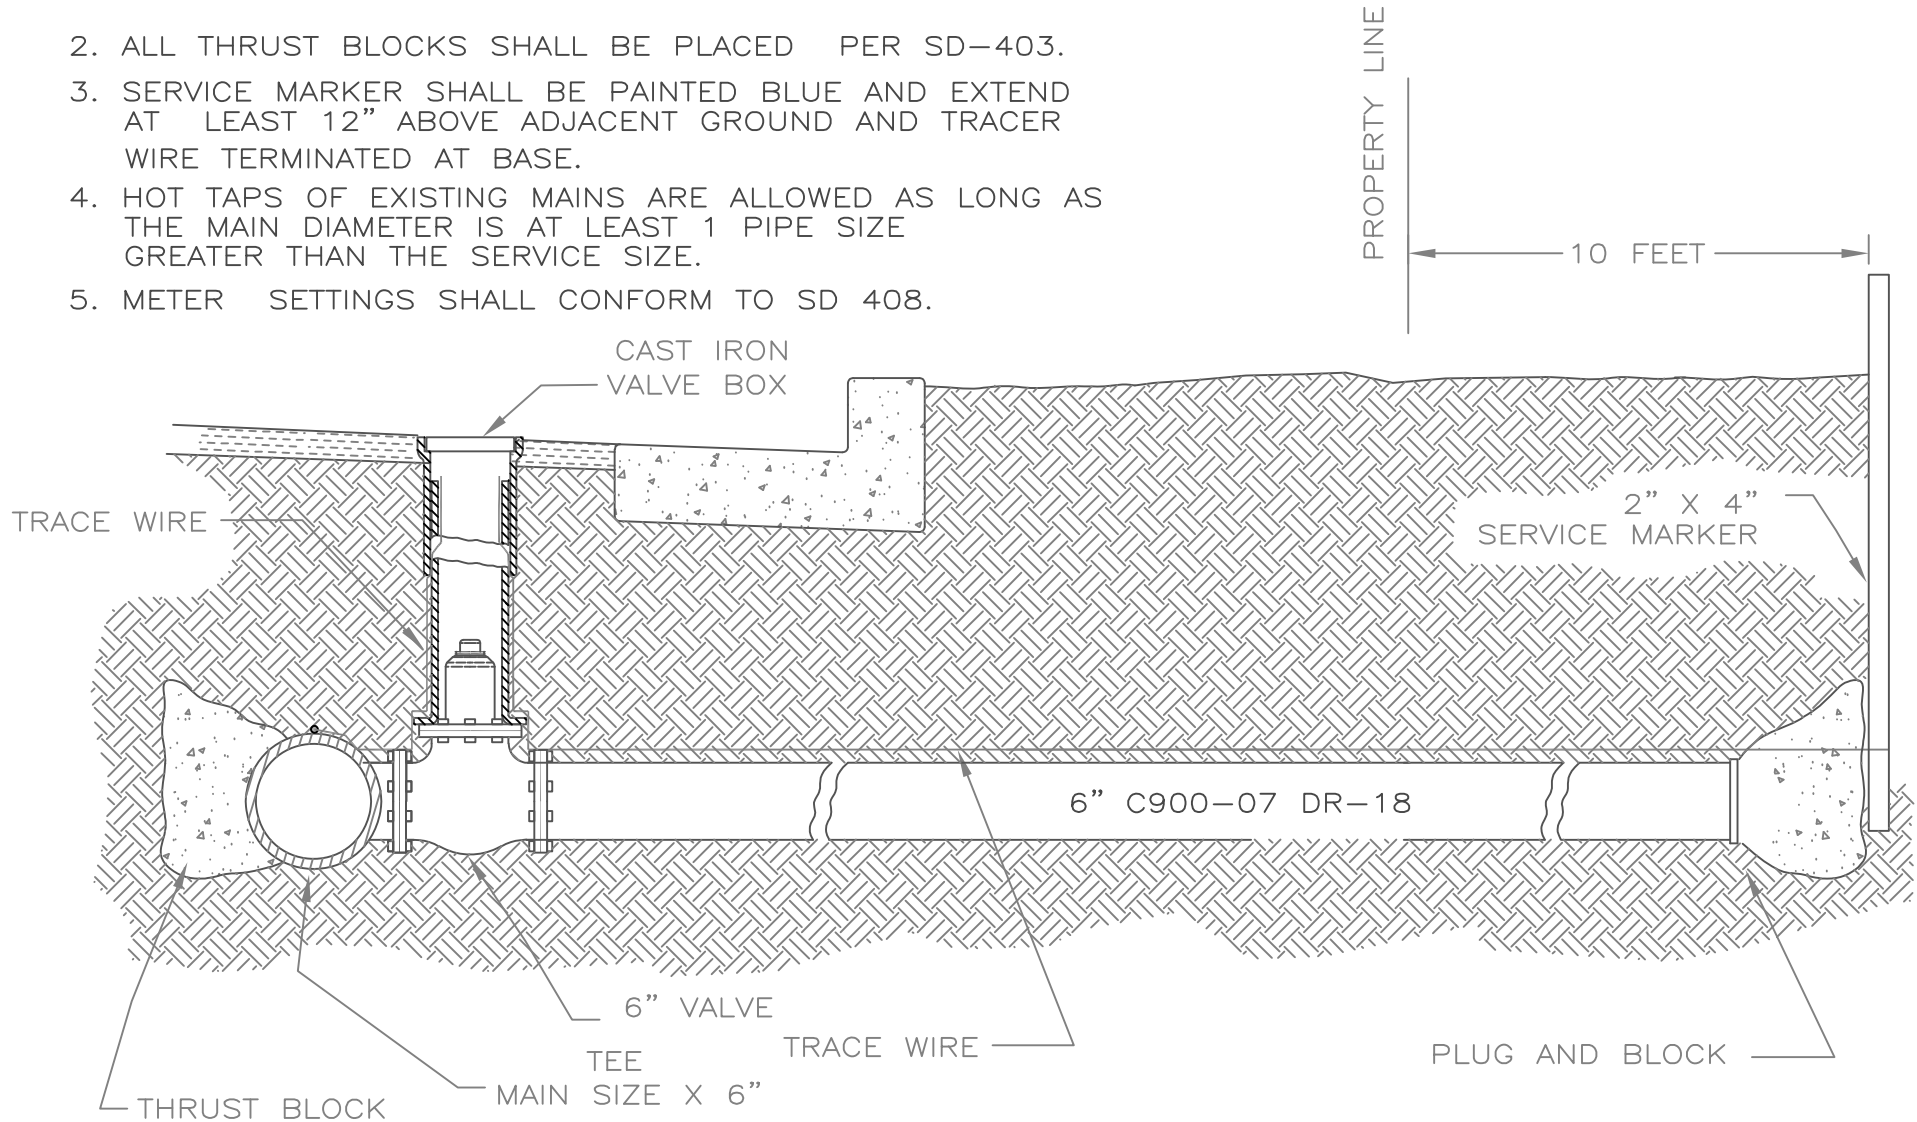

APPROVED BY:

POST FALLS STANDARDS FOR PUBLIC WORKS CONSTRUCTION

*[Signature]* 3/19/19  
CITY ENGINEER, P.E. DATE:

**6" WATER SERVICE**

STANDARD DRAWING  
NO. SD 407