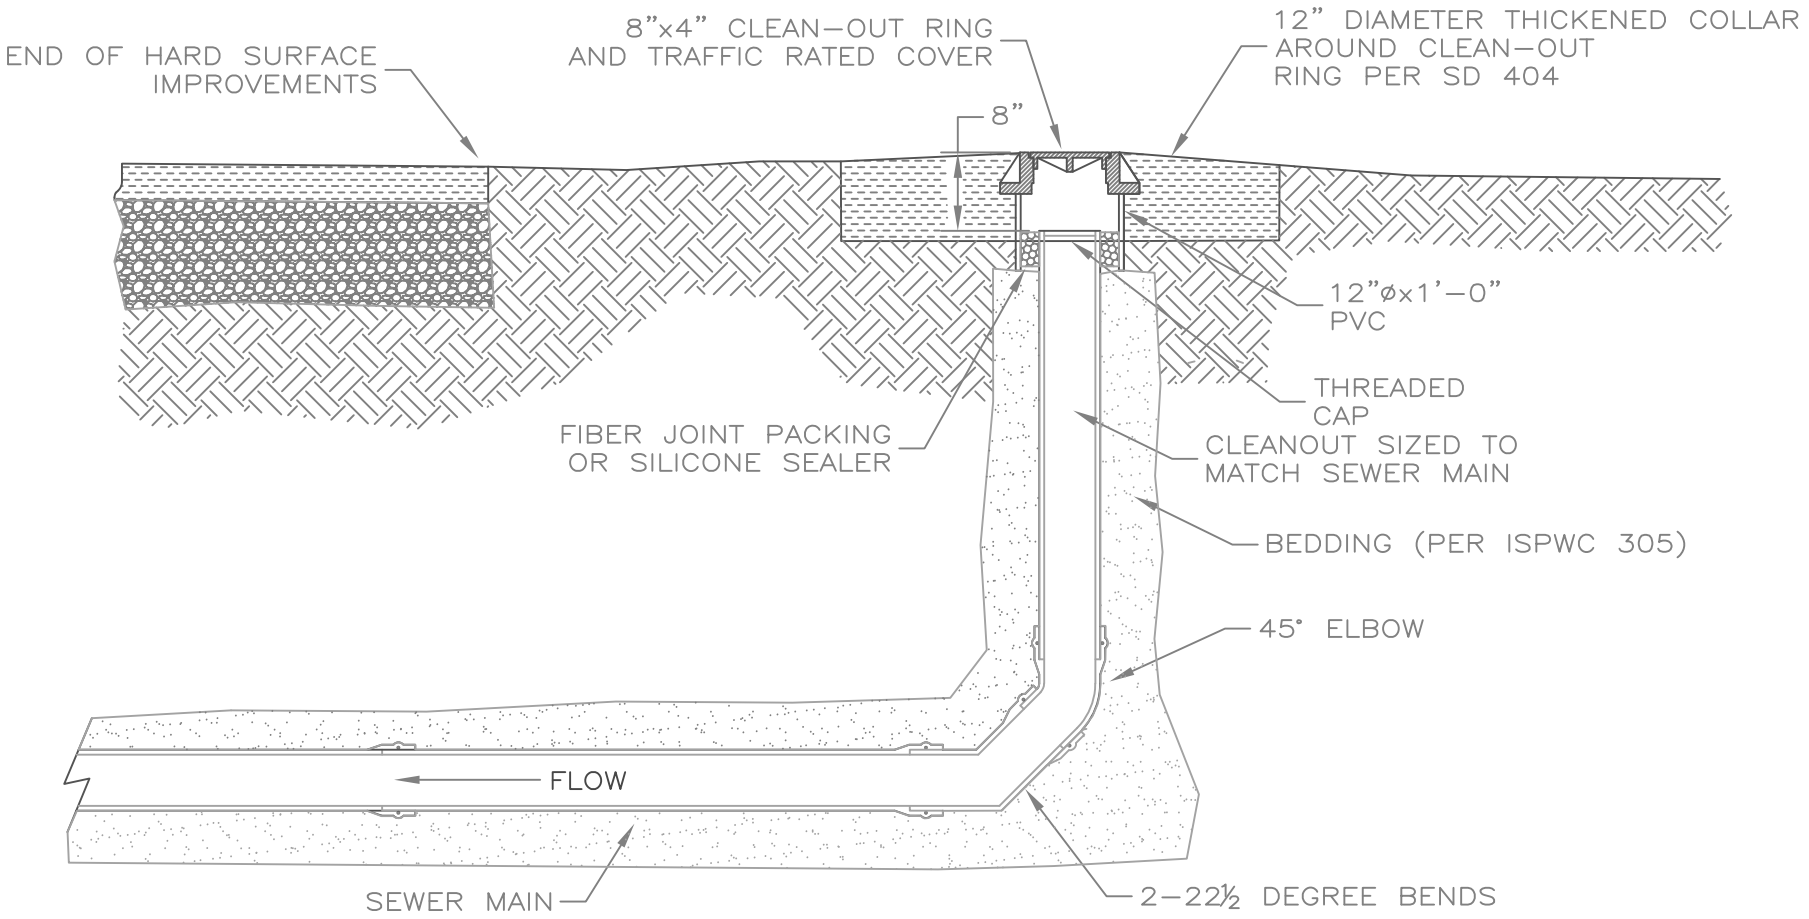

NOTES:

1. ALL PIPE TO BE ASTM 3034 SDR35.

APPROVED BY:	POST FALLS STANDARDS FOR PUBLIC WORKS CONSTRUCTION	STANDARD DRAWING
CITY ENGINEER, P.E. — DATE: 3/19/19	SEWER CLEAN-OUT DETAIL	NO. SD 506